


DOUBLE SERVICE

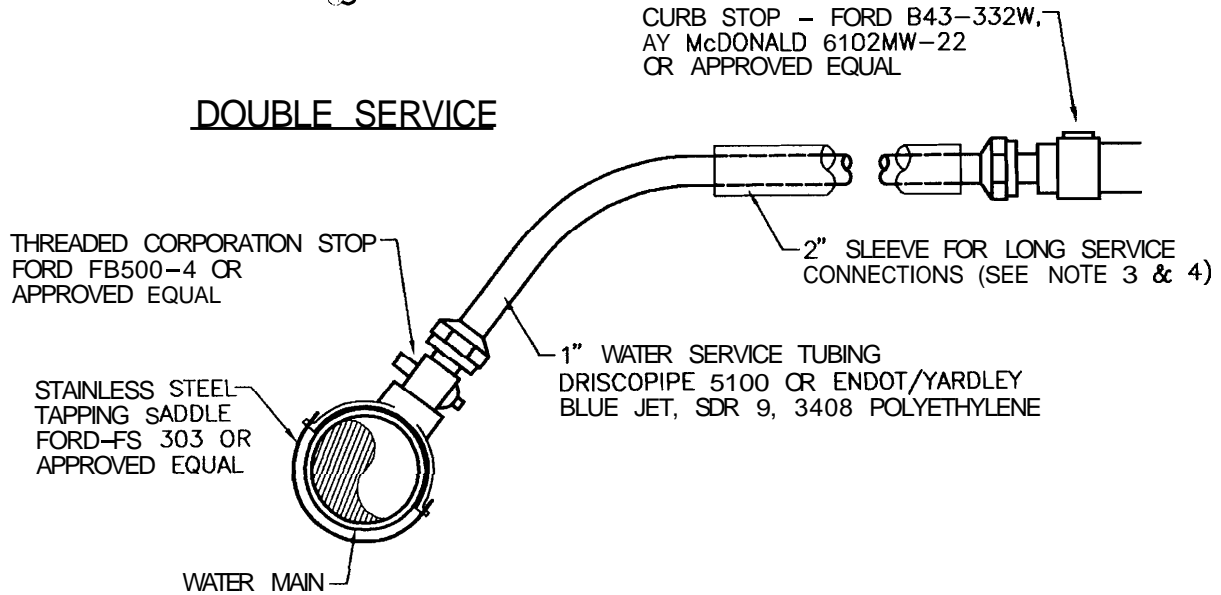

NOTES:

1. MINIMUM DISTANCE BETWEEN SERVICE TAPS TO BE NOT LESS THAN 36".
2. TEN FT SEPARATION REQUIRED BETWEEN PARALLEL WATER AND SEWER LINES
3. SERVICE LINES UNDER THE ROADWAY SHALL BE ENCASED IN PVC CLASS 160 OR HDPE MEETING LEE COUNTY STANDARDS. CASING TO EXTEND A MINIMUM OF 5 FT BEYOND THE EDGES OF THE PAVEMENT OR BACK OF CURB.
4. LONG SERVICE CONNECTIONS - SERVICE CONNECTIONS THAT MUST CROSS UNDER THE ROADWAY. SHORT SERVICE CONNECTIONS - SERVICE CONNECTIONS THAT ARE LOCATED ON THE SAME SIDE OF THE ROADWAY AS THE DISTRIBUTION MAIN.
5. DOW MODEL 1200 METER BOX WITH CAST IRON LID TO BE SUPPLIED BY DEVELOPER AND LOCATED INSIDE R.O. AT PROPERTY LINE AND CLEAR OF DRIVEWAY.

WATER SERVICE CONNECTION DETAIL

NTS