



NOTE: CONFIGURATION SHOWN TO BE IN PLACE FOR PRESSURE TESTING & BACTERIAL CLEARANCES.

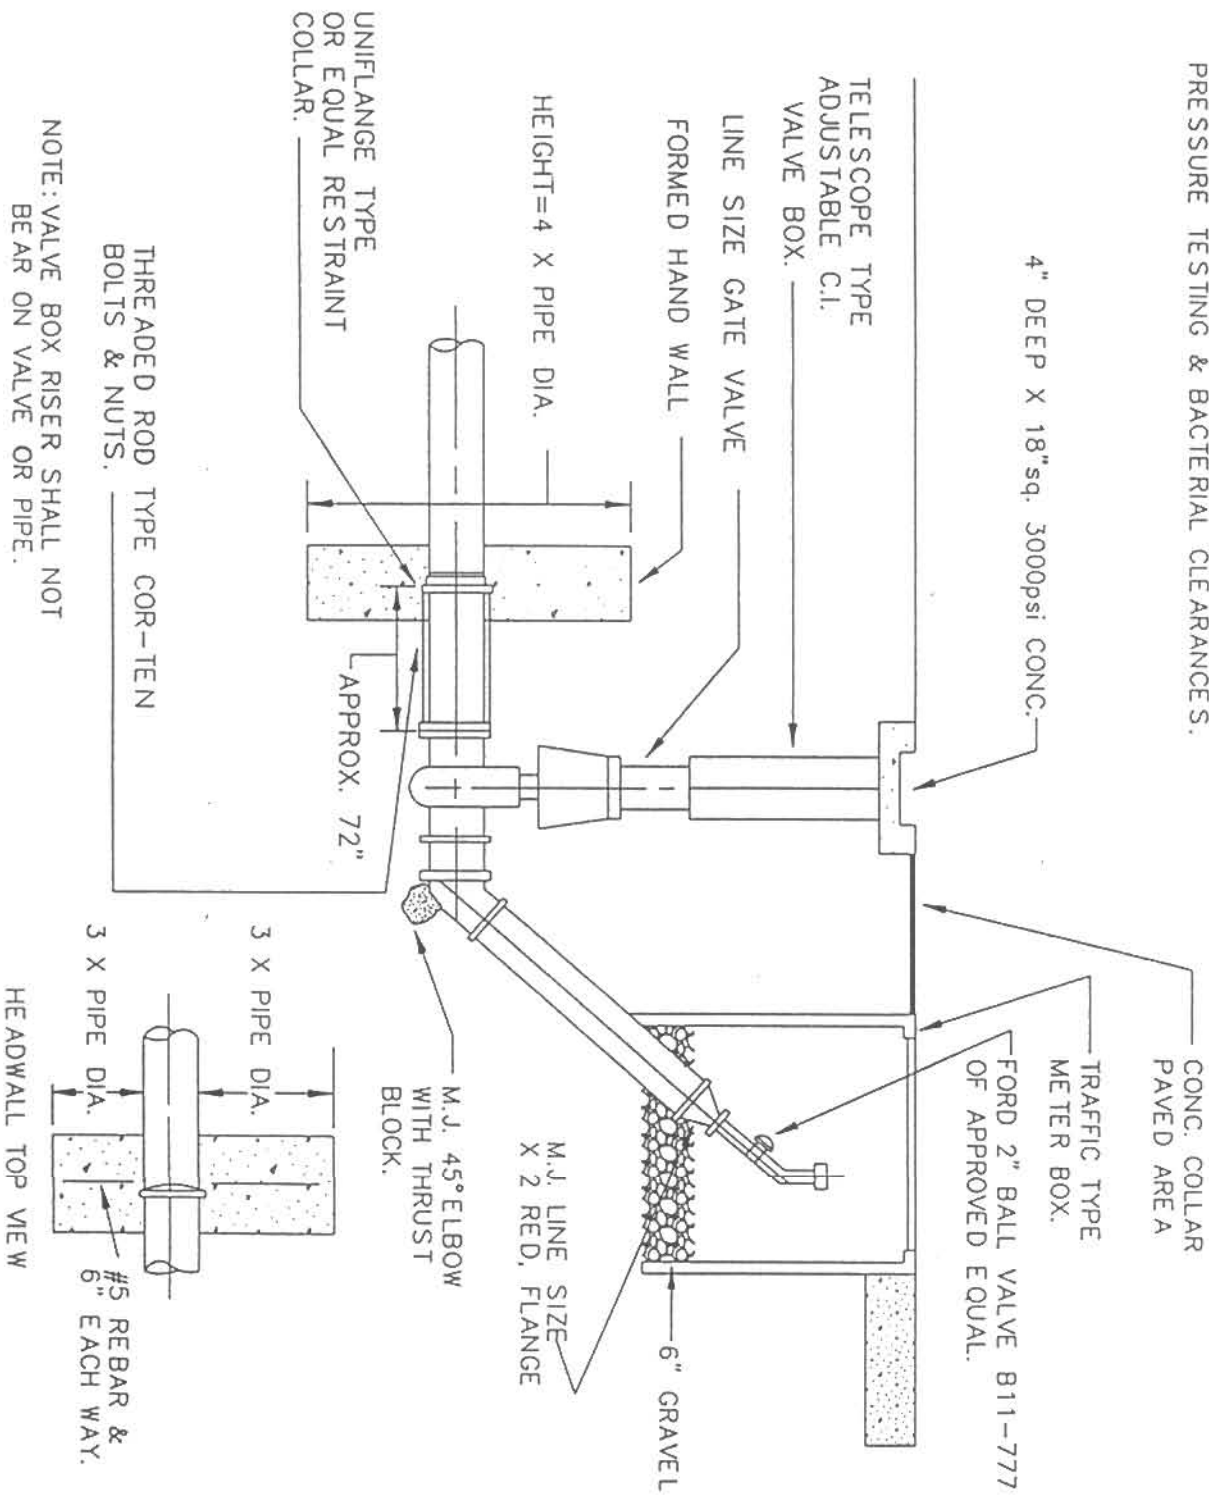

NOTE: VALVE BOX RISER SHALL NOT BEAR ON VALVE OR PIPE.

HEADWALL TOP VIEW

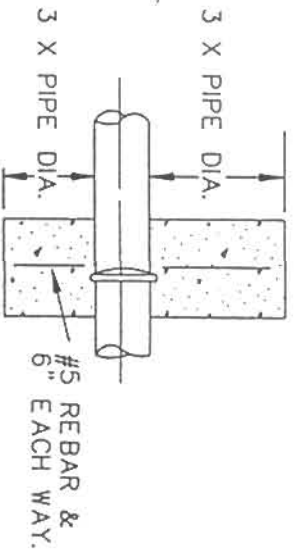

BLOW-OFF DETAIL

SCALE: N.T.S.
DATE: 11/02/93
CHK:
Dwg #: W-5